

BERGISCHE UNIVERSITÄT
WUPPERTAL

GAUSS-STRASSE 20
42097 WUPPERTAL
TELEFON ++49 (0)202-439-0
www.uni-wuppertal.de



Fachbereich 14

SICHERHEITSTECHNIK

Fachgebiet
Sicherheitstechnik/Arbeitssicherheit
Univ.-Prof. Dr.-Ing. G. Lehder

Bergische Universität Wuppertal, Fachbereich 14
Gaußstraße 20, 42097 Wuppertal

Superior Manufacturing Group-Europe B.V.
Anja Gehring
Achterzeedijk 57

NL – 2992 SB Barendrecht

Netherlands

Datum: 03.07.03
Gesprächspartner: Dipl.-Ing. U. Windhövel
Aktenzeichen: FB 14 – Wi
Durchwahl: (0202) 439 – 2127
Telefax: (0202) 439 – 3782
Gebäude, Ebene, Raum: U – 14.11
E-mail: windh@uni-wuppertal.de

TEST REPORT


Assessment of anti-slip properties with the inclining ramp test method in accordance with DIN 51130 and BGR 181

Reference: Your commission of 05/06/2003

Test Sample: Industrial Matting #410 AIRUG®
thickness 9,4 mm

Sample-No.: F 440

Date of Test: 27/06/2003

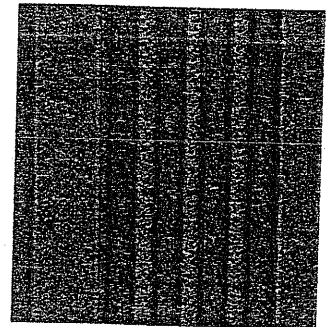

Test Equipment: According to your instructions, the slip resistance of the floor covering was tested with the walking method - ramp test - in accordance with DIN 51130 [Testing of floor coverings; determination of the anti-slip properties; workrooms and fields of activities with raised slip danger]. The critical angle of inclination was found out with the ramp test (see enclosure) with two test persons. The test persons were calibrated at the same day.

Result of the testing and assessment: The mean acceptance angle of both test persons was 18,2 degrees.

According to DIN 51130 and the BG-rule BGR 181, the sample is in assessment group R 10.

Validity Period of Test Report: This Test Report is effective, with consideration of all sorts of modifications in regulations and technical innovations, for a period of five years.

Remark: This Test Report applies to the floor covering with the inspected surface as described above.

(Prof Dr. Lehder, Head of Department)

(Dipl.-Ing. Windhövel, Head of Laboratory)